



## INSTALLATION SCHEMA :

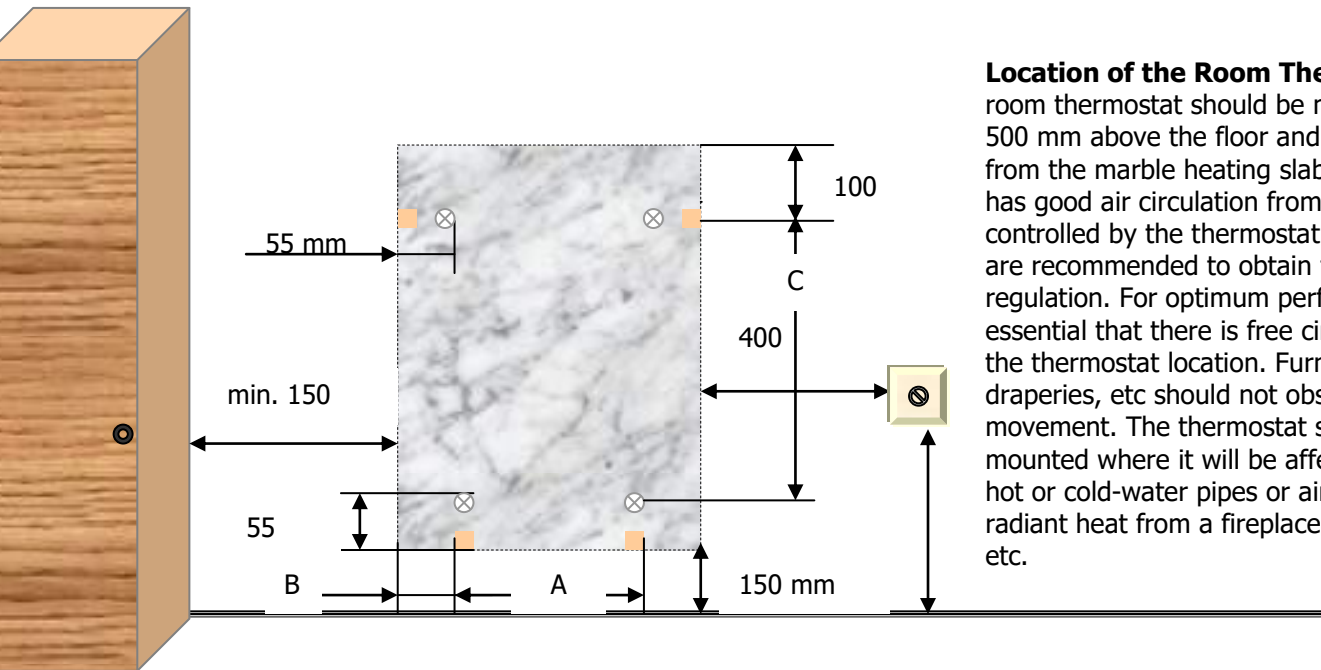

**Location of the Room Thermostat** — The room thermostat should be mounted 300 – 500 mm above the floor and 300-400 mm from the marble heating slab, on the wall that has good air circulation from all areas being controlled by the thermostat. These distances are recommended to obtain the best regulation. For optimum performance, it is essential that there is free circulation of air at the thermostat location. Furniture, doors, draperies, etc should not obstruct air movement. The thermostat should not be mounted where it will be affected by drafts, hot or cold-water pipes or air ducts in walls, radiant heat from a fireplace, lamps, sun, TV, etc.

A minimum 1500 mm clearance at the front of the unit is recommended!

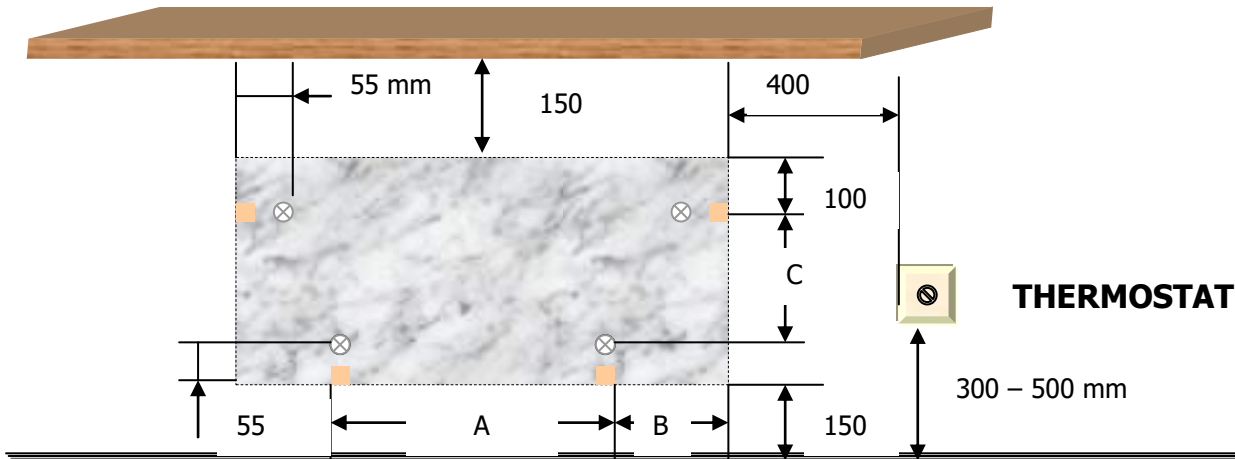